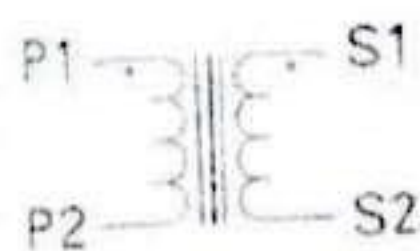


济南圣鸿电子有限公司

成品出厂检验报告

产品名称		电流互感器		检验方式		抽检		检验标准		GB20840.2-2014		检验日期		2022.6.14		产品批号		06090011		
检验条件		室温、HES-1S数字式互感器校验仪、HY2672S耐电压测试仪 万用表4#																		
技术参数										测试记录										
产品型号	产品参数	负载	工作频率	初级电阻	次级电阻	引线引针	绝缘电压	使用温度	端子标志	过载倍数	外观	序号	比差	角差	误差检测记录					
															5%	20%	50%	100%	120%	
BH501	800A/5A	5VA	50-400Hz	/	0.1 Ω	良好	3000V/min	-25 $^{\circ}$ C +75 $^{\circ}$ C	PIR 515L	1.2	良好	1	f(%)	-0.13	-0.05	0.02	0.06	0.06		
					0.1 Ω							2	δ (')	13	9	5	3	2		
													f(%)	-0.16	-0.05	-0.01	0.04	0.03		
					0.1 Ω							3	δ (')	14	9	6	3	3		
													f(%)	-0.25	-0.12	-0.06	0.02	0.02		
												4	δ (')	18	12	8	4	3		
													f(%)							
													δ (')							
													f(%)							
													δ (')							
													f(%)							
													δ (')							
													f(%)							
													δ (')							
													f(%)							
													δ (')							
													f(%)							
													δ (')							
备注	端子标志:					结论					合格					其他				
											质检员: 王瑞琪					特殊情况处理记录: 无				
																审核记录: 合格				
																质检部: 王瑞琪				